

Retraction

Retracted: Optimization Technique for Renewable Energy Storage Systems for Power Quality Analysis with Connected Grid

International Transactions on Electrical Energy Systems

Received 28 November 2023; Accepted 28 November 2023; Published 29 November 2023

Copyright © 2023 International Transactions on Electrical Energy Systems. This is an open access article distributed under the Creative Commons Attribution License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

This article has been retracted by Hindawi, as publisher, following an investigation undertaken by the publisher [1]. This investigation has uncovered evidence of systematic manipulation of the publication and peer-review process. We cannot, therefore, vouch for the reliability or integrity of this article.

Please note that this notice is intended solely to alert readers that the peer-review process of this article has been compromised.

Wiley and Hindawi regret that the usual quality checks did not identify these issues before publication and have since put additional measures in place to safeguard research integrity.

We wish to credit our Research Integrity and Research Publishing teams and anonymous and named external researchers and research integrity experts for contributing to this investigation.

The corresponding author, as the representative of all authors, has been given the opportunity to register their agreement or disagreement to this retraction. We have kept a record of any response received.

References

- [1] R. Senthil Kumar, B. V. S. Acharyulu, P. K. Dhal et al., "Optimization Technique for Renewable Energy Storage Systems for Power Quality Analysis with Connected Grid," *International Transactions on Electrical Energy Systems*, vol. 2023, Article ID 4675421, 7 pages, 2023.

Research Article

Optimization Technique for Renewable Energy Storage Systems for Power Quality Analysis with Connected Grid

R. Senthil Kumar,¹ B. V. S. Acharyulu,² P. K. Dhal,³ Richa Adlakha,⁴ Sonu Kumar,⁵ C. Saravanan,⁶ and Krishna Bikram Shah⁷

¹Department of Electrical and Electronics Engineering, SRMIST, Kattankulathur-603203, Chengalpattu District, Tamilnadu, India

²Department of Electrical and Electronics Engineering, Lendi Institute of Engineering and Technology, Jonnada (village), Denkada Mandal, Vizianagaram 535005, Andhra Pradesh, India

³Department of Electrical and Electronics Engineering,

Vel Tech Rangarajan Dr.Sagunthala R& D Institute of Science and Technology, Chennai, Tamil Nadu 600062, India

⁴Department of Electrical and Electronics Engineering, Manav Rachna International Institute of Research and Studies, Faridabad, Haryana, India

⁵Department of Electronics and Communication Engineering, Koneru Lakshmaiah Education Foundation, K L Deemed to be University, Vaddeswaram, Guntur District, Andhra Pradesh-522302, India

⁶Department of Electrical and Electronics Engineering, J.K.K.Munirajah College of Technology, T.N.Palayam-638506, Erode Dt, TN, India

⁷Department of Computer Science and Engineering, Nepal Engineering College, Changunarayan, Bhaktapur, Nepal

Correspondence should be addressed to Krishna Bikram Shah; krishnabs@nec.edu.np

Received 22 September 2022; Revised 28 October 2022; Accepted 24 November 2022; Published 10 May 2023

Academic Editor: Nagamalai Vasimalai

Copyright © 2023 R. Senthil Kumar et al. This is an open access article distributed under the Creative Commons Attribution License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

Power quality is the main problem with the power system network. Poor electricity quality may cause disruptions and financial challenges for consumers. Additionally, it could cause electronic gadgets to overheat, be damaged, or operate inadvertently. Transformers and other components of the power distribution system may also overheat and experience core saturation. This study investigates potential problems with the quality of the electricity in a photovoltaic linked power system. This paper suggests a new optimization method for day-ahead trading and control in DC microgrid power management (MG). The goal of the multiobjective optimization dispatch (MOOD) problem is to lower overall operational costs as well as the costs associated with power loss in efficient conservation systems and exhaust emission quantities such as nitrogen oxides, sulphur dioxide, and carbon dioxide. Using the weighted sum approach, the multiobjective optimization problem is reduced to a single optimization problem. The analytical hierarchy process (AHP) method is then used to calculate the weight coefficients while accounting for each objective function's preferences. Power balancing, high levels of renewable energy penetration, the most effective scheduling of battery charging and discharging, control of load curtailment, and the technical limitations of the system are all taken into account when evaluating the system's performance in both grid-connected and standalone operation modes. The ant lion optimizer (ALO) technique is taken into account to tackle MOOD, comparing the effectiveness of the proposed method to other well-known heuristic optimization techniques. The simulation's results demonstrate how effectively the proposed strategy can address the coordinated control and optimization dispatch difficulties. They also found that operating the MG system economically in grid-connected mode can save overall costs by roughly 4.70% compared to doing it in independent mode.

1. Introduction

In the aim of meeting the enormous requirement for electrical power in today's climate, hybrid renewable energy sources (or HRES) in conjunction with the grid connectivity are becoming more crucial [1–3]. This integration lessens environmental issues and the consumption of fossil fuels even further. In grid-connected systems, devices like battery energy storage systems (BESS), HRES, photovoltaic or the PV systems, and wind turbines are posing problems with the management of quality of power [4–6]. The underdeveloped or very less industrialized countries in Sub-Saharan Africa (SSA) face difficult obstacles when trying to make investments in renewable energy options because countering climate change issues brought on by excessive fossil fuel use comes with high initial costs. This is particularly true considering the region's modernisation. Nevertheless, other economic and environmental criteria are typically taken into account when constructing renewable energy systems [7–9].

Numerous environmental problems result from the production of energy using conventional techniques. One of the potential options for generating clean, effective energy is the fuel cell (FC), a novel renewable energy source. A mismatch between power generation as well as load power results in a departure from the required voltage and frequency in the power supply because renewable energy sources are unreliable [10]. A novel control method for the power flow regulation with the unified power flow controller (UPFC) in grid-connected hybrid renewable energy systems, like photovoltaic-wind, has been presented to address this issue. Distributed generation are DGs that produce power using renewable energy (DER). One of the DER systems with the highest promise is solar photovoltaic (PV), which uses just sunlight, a free and clean source of energy, to produce electricity. To avoid problems with power outages, the centralized power plant may need to boost the grid's reserve power as a result of the increased use of DER. In addition, the system may experience power quality problems as a result of the growing penetration level. Power quality is the most crucial component in power distribution systems. It is described as the utility's capacity to give customers steady, noise-free electricity. Electronic devices and parts of the electricity distribution system would be damaged by poor power quality because frequency variations would induce operation in undesirable areas. Higher DER penetration is necessary in order to produce more power. However, this also implies that there might be a load power mismatch at any time.

This paper is organized as different sections, which are literature review as Section 2, proposed work as Section 3, results and discussion as Section 4, and conclusions as Section 5.

2. Literature Review

Atom search optimization (or ASO) and a unified power flow controller (or UPQC) are recommended in conjunction with the HRES system to address these issues. A number of specialist power devices such as UPQC are used to efficiently

reduce PQ issues like voltage, current sag, swell, and total harmonic distortion. The UPQC will be driven by a fractional order PID controller using system parameters created using the ASO technique. The best results are obtained when the results are compared to the PI. The MATLAB/Simulink application is used to represent the test system [11]. This research presents an intelligent control technique for grid-connected hybrid power systems combining solar-based PV, the wind turbines along with the storage of battery power to attain the optimum power quality enhancement (OPQE). Within this suggested hybrid renewable energy sources (HRES) system, the unified power quality conditioner with active and reactive power (UPQC-PQ) is constructed with a fractional-order proportional integral derivative (FOPID) controller based on atom search optimization (ASO). The fundamental goal has been to control voltage while reducing the power loss and the total harmonic distortion (THD). The UPQC-PQ uses the ASO-based FOPID organiser to alleviate power quality (PQ) issues like sag, swell, disturbances, real and reactive power, and THD minimizations connected to voltage and current. The novel approach is presented in a variety of modes, including $PRES > 0$, $PRES = 0$, and simultaneous PQ reinforcement and RES power injection. The effectiveness of the suggested methodology is determined by comparing the results to those obtained utilizing earlier literature approaches, including PI controller, BBO, ESA, GSA, RFA, GA, and GWO. The model has now been made using the MATLAB and the Simulink work-based architecture [12]. The supply gap in Sierra Leone was addressed in [13] by using the multiobjective particle swarm optimization (MOPSO) method to size ten grid-connected hybrid cubes that were optimally distributed among photovoltaic (PV) modules, onsite wind turbines, and the biomass gasification plants with the sugarcane bags, battery energy storage systems (BESS), and the diesel generation systems as the optional power. In Kabala, which is a district in the Northern and Kenema District in Southern Sierra Leone, potential plant sites for PV, wind, and biomass were subjected to well-established methodologies for resource assessment. The ten hybrid modules underwent long-term analysis with the following goals in mind: reducing the probability of a deficient power supply, the diesel energy portion, the life span costs, and carbon dioxide (CO_2) emissions. Kabala area is the practical location for PV and the wind farm projects, according to generating capacity of 27.4 percentages and 31.7 percentages for PV and wind, respectively. The comparison of the optimal results across selected blocks for DPSP values of 0–50% identifies the most cost-effective and ecologically beneficial course of action that policymakers in Sierra Leone and the surrounding area could take in circumstances like these [13]. For the purpose of meeting the enormous requirement for electric power, hybrid renewable energy sources (HRES) connected to the grid has become far more significant. With this incorporation, the usage of fossil fuel is being progressively reduced, as are environmental issues. HRES in grid-connected systems, such as the solar (PV) systems, the wind turbines (WT), and the battery energy storage systems (BESS), are affecting the electricity quality. Black widow optimization (BWO) with distributed

power flow controller (DPFC) has been suggested as a solution to these problems in the HRES system. One of the many bespoke power devices, including DPFC, is useful in reducing PQ problems such as voltage and current sagging, swell, total harmonic disturbances, and shattered order. The BWO approach is used to create the control parameters for the DPFC, which is driven by a PID controller. The analysis produced the greatest findings when it was compared to different techniques, including PSO, BWO, and GA. Software called MATLAB/Simulink is used to simulate the test system [14]. This research suggests an effective method for managing the power flow of hybrid renewable energy systems coupled with smart grid systems. The suggested method in this case combines the MEHOTSA tabu search algorithm with the modified elephant herding optimization technique. In the suggested technique, the evaluation process is carried out to identify the appropriate control commands for such architecture as well as to create the switching pulses datasets for the standalone approach while taking into account the power disparity in between generator and the load sides. The multiobjective functions are built using the reactive and active power categories generated for the grid depending upon the source power that seems to be easily obtainable. The finished dataset is used to hasten the completion of the control operation by running the Tabu search algorithm online. The recommended technique-based modeling approach enhances the power operator's system parameters in the context of the various power flow kinds. The power flow management within the smart grid system is managed depending on the power supply and load side parameter variants by using the proposed approach. The suggested technique is also in charge of managing the energy sources to generate the required amount of electricity for the grid, making best use of both energy storage devices and renewable energy sources. Finally, the performance of the suggested model is evaluated in comparison to alternative methods using the MATLAB/Simulink platform [15]. The voltage stability of the grid-connected FC is improved in this study using boost converters, a 25-level cascaded H-bridge (CHB) multilevel inverter (MLI), and traditional PID controllers. Two PID controllers had been used to control the MLI linked to the grid for controlling the point of common coupling (PCC) voltage between the FC and the grid. The PID optimizers are tuned for dynamic processes using traditional evolutionary techniques like particle swarm optimization (PSO) and squirrel search algorithm (or SSA). An improved squirrel search algorithm (ISSA) has indeed been suggested in this study to significantly improve the convergence speed of computation and precision of the traditional methodologies used. This article's grid-connected power network was created in the MATLAB and Simulink environment. To evaluate the efficiency of the suggested controller, the systems also are subjected to a number of demanding voltage sag and swell situations. The development of the voltage profile, the enhancement of the power quality, and the shorter execution time of the suggested ISSA approaches have been featured in a full comparison with the traditional PID, PSO, SSA, and ISSA techniques. The results show how

the suggested strategy outperforms the conventional ones in the aspects of better dynamic voltage responsiveness, increased power quality, and decreased harmonics. Total harmonic distortion (THD) analysis is utilized to determine the power quality indicators. The numbers obtained validate the proposed controller's real-time implementation because they are well within the IEEE-547 indices [16]. The suggested control method combines a recurrent neural network and the binary version of the grey wolf optimization (bGWO) (RNN). The dataset of control signals for the UPFC's shunt and series converters is produced here using bGWO. The RNN approach executes and forecasts the ideal control signals of the UPFC based on the completed dataset. Similar to this, suggested control strategy reduces power losses while controlling voltage variation. The suggested model is then put into practice in the working stage of Matrix Laboratory and Simulink, and the effectiveness of the execution is evaluated using current approaches, including fuzzy logic controller, improved particle swarm optimization, and grey wolf optimization. Analysis is also done on the suggested and the existing techniques' optimal gain parameters and elapsed times. The suggested hybrid technique's optimum gain parameters, such as $K_p K_i$, are 2.5 and 150. The suggested methodology took 30.15 seconds to complete. Overall, the comparison findings show the suggested technique's superiority and prove its ability to resolve the aforementioned issues [17].

3. Proposed Work

Multiple MGs are used in the proposed architecture's design. For the purpose of measuring the power flow in a specific MG, the separate MGs are deployed with an SM. Let us say, created MMG configuration consists of six MGs, denoted as MG1, MG2, MG3, MG4, MG5, and MG6, and the six matching SMs, denoted in the form of SM1, SM2, SM3, SM4, SM5, and SM6. The utility grid (UG) and MGs are shown in Figure 1's representation of the system.

An MG is made up of RES like solar and wind energy along with battery storage. Grid-connected or island-based modes can meet consumer demand. Each MG is connected to an electricity line heading toward the UG and an information line coming from the SM. The information stream coming from SMs is getting closer to the central controller. A multiple stage unique EMS is used to carry out the suggested MMG. Predicting the MG's operating mode comes first, then managing energy in islanded mode, and ultimately, updating the MG status for precise operation mode predictions utilizing future states. The unique entities known as SMs are able to track and produce precise values of the power flow. Such parameters enable the control and administration of energy. The central controller collects the fluctuations in electricity output and consumption on each MG for use in making decisions. The MGs are operated in accordance with the central controller's judgment. On the other side, MG status is tracked in order to forecast MG state in the future. The efficient management of energy is ensured by the precise assessment of the operation mode. It is suggested to use the innovative three-stage RES-GRID to

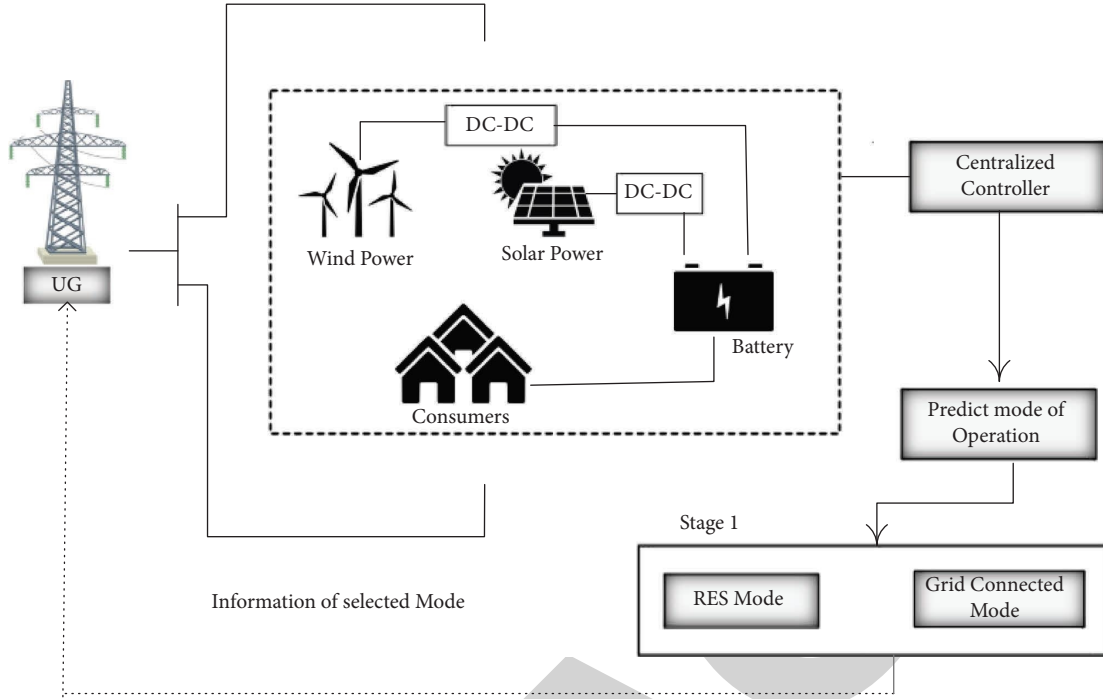


FIGURE 1: Proposed RES-GRID model.

control energy effectively through wise mode selection and power exchange. Grid-connected modes as well as islanded modes are the two categories under which operation modes in MMG are categorized. A form of operation for islands, the self-electrical sources that MG is intended to have, are utilised to meet consumer demand. Due to the usage of renewable resources, electricity generation in this mode is not constant. Renewable energy resources like wind power and the solar energy are dependent on the nature and cannot supply electricity continuously. Since it continuously and autonomously creates the same quantity of electricity, the grid-connected operation mode differs from the islanded mode. Here, the weather has a big impact on how much power MGs can generate. Neural networks (NNs) are concerned about the analysis of climatic variables nearby the MG in order to precisely anticipate the mode.

At this stage, the meteorological data for each MG is extracted, and each is assigned an operation mode. Since wind and solar power are used in this application, the corresponding weather variations include wind speed and the light intensity. Generally, the measurements of monochromatic radiation's frequency are used to quantify light intensity. Let L represent the expected light level at time t . As shifting seasons additionally have an impact on solar activity, it is anticipated that this investigation will make use of luminance measurements taken throughout the summer months. Then, perhaps the wind speed is considered for the wind turbine's renewable resource. Traditionally, height of the turbine hub is used to differentiate the wind speed. Depending on the wind turbine's elevation, the air's density varies. W should represent the wind speed at time T . Ambient limitations are incorporated into NN to determine the operating mode.

The operation of human brain neurons is mimicked in a machine learning system known as NN. The back-propagation algorithm-based NN structure is made up of the structures of the input, hidden neurons, and output neurons. The input layer's neurons are interconnected with the hidden layer's neurons, and all of the hidden layer's neurons are connected to the output layer's neurons. The suggested NN works well when dealing with difficult decision-making problems. Let links be the means by which the succeeding layers of neurons are connected, with M and N being two neurons and their individual weights being $w_{(i,j)}$. An activation function is then used to convert the information needed to calculate the weighted sum from propagation functions into an input for the subsequent layer. Thus, the input from MG_1 is given as net_{MG_1} , consider $M = \{i_1, i_2, i_3, \dots, i_n\}$. With this, propagation function is demonstrated as

$$NET_{MG_1} = F_{Pro}(O_{i1}, O_{i2}, \dots, O_{in}, W_{i1,j}, W_{i2,j}, \dots, W_{in,j}). \quad (1)$$

The proliferation purpose F_{Pro} is composed of subjective values and results from other levels and is denoted by $(o_{i1}, o_{i2}, \dots, o_{in})$. Individual neurons are multiplied by the weight $w_{i,j}$ to anticipate the weighted sum. Whenever it exceeds the threshold value, the activation function is employed to stimulate the neurons. In this case, the activation function is defined as, where I is the threshold of the i th neuron.

$$A_i(t) = F_{act}(net_i(t), A_i(t-1), \Theta_i). \quad (2)$$

F_{act} (activation function) $A_i(t-1)$ stands for the former activation state, that is, changed into $A_i(t)$, which is the new activation state, and signifies the activation function. In

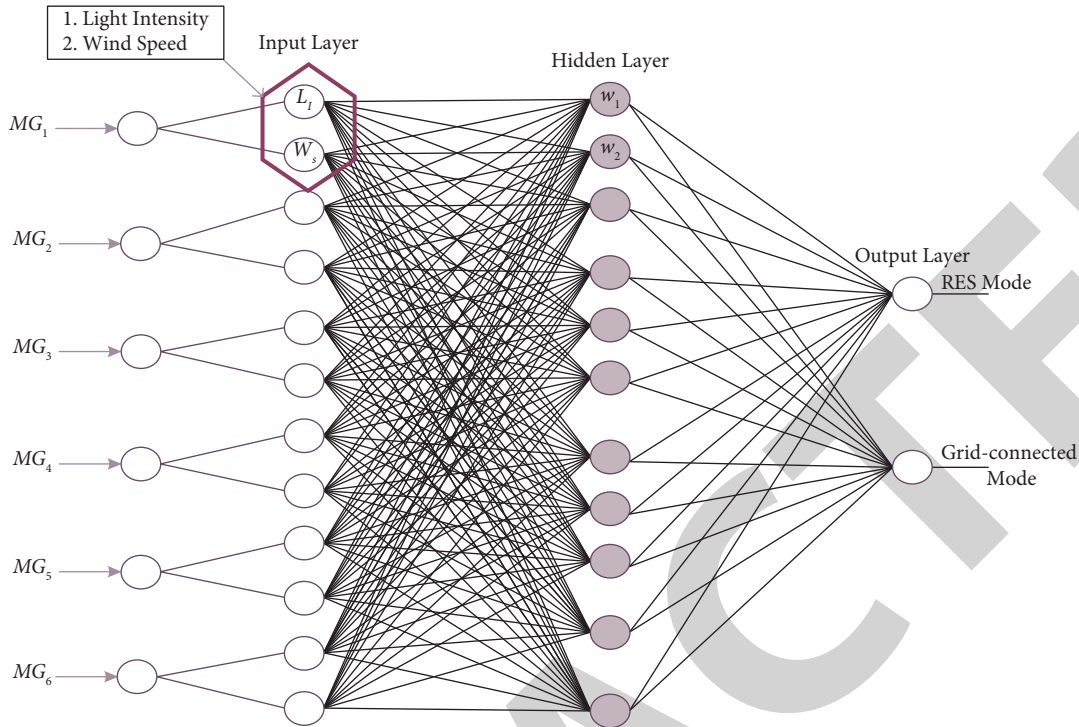


FIGURE 2: Neural network structure for mode selection.

order to improve output accuracy, the neurons in the NN are given the capacity to fine-tune the connection's standard. The operation mode of the neural network is decided upon using training samples made up of various L I as well as W S values. On the other hand, stage 3's evaluation of future state guarantees correct operation selection prediction. Given that MGs are dispersed across the environment, it is important to take into account the major RES restrictions while determining their mode of operation. Additionally, since their ability to produce power is dependent on natural resources, light intensity as well as the wind speed has to be taken into account when determining how they will operate. Poor weather conditions tend to restrict productivity, which manifests in the unmet needs of the customer. In this scenario, the MGs are run in grid-connected mode until a specific range of RES production is reached. The islanded MG is then transferred to stage 2 processing shown in Figure 2.

4. Results and Discussion

The suggested RES-GRID performance is validated in this section by creating it with the proper programming. Comparative results and the simulation environment make up this section's two subcategories. MATLAB Simulink is used to investigate the proposed RES-GRID model. This software is a graphical programming environment with a focus on creating dynamic RES networks. The three stages for processing of mode identification, energy conservation, and future state prediction in MatlabR2017b suits well for the creation of RES-GRID. Integrated on the Windows operating system is MatlabR2017b.

TABLE 1: Simulation setup.

Parameters	Specifications	
Number of PV	5	
Number of microgrids	5	
Wind mills count	5	
Simulation time	200 s	
Renewable energy capacity	Battery	150 kW
	Wind	60 kW
	PV	60 kW
External grid	200 kW	
Mode of operation	Islanded/grid-connected	

The presented RES-GRID specifications are listed in Table 1 and are taken into account in our layout. These restrictions do not stop there; the modeled RES-GRID is made up of six microgrids, each with a different load. The controller chooses their operational mode based on their production. Mode prediction, energy management, and power exchanges are used to carry out three-stage measurements based on these parameters. In island mode, energy management is focused. Figure 3 shows fluctuation rate and grid-connected mode.

Figure 4 shows about RES mode and grid-connected mode. The suggested approach also functions well in aspects of convergence rate and duration, taking less time and iterations to resolve to the global optimal solution. Additionally, it should be noted that each optimization algorithm has a maximum iteration constraint of 200 and a population restriction of $Np = 40$. In conclusion, we believe that using the ALO algorithm to resolve the overall objective function significantly reduces the overall cost and validates the

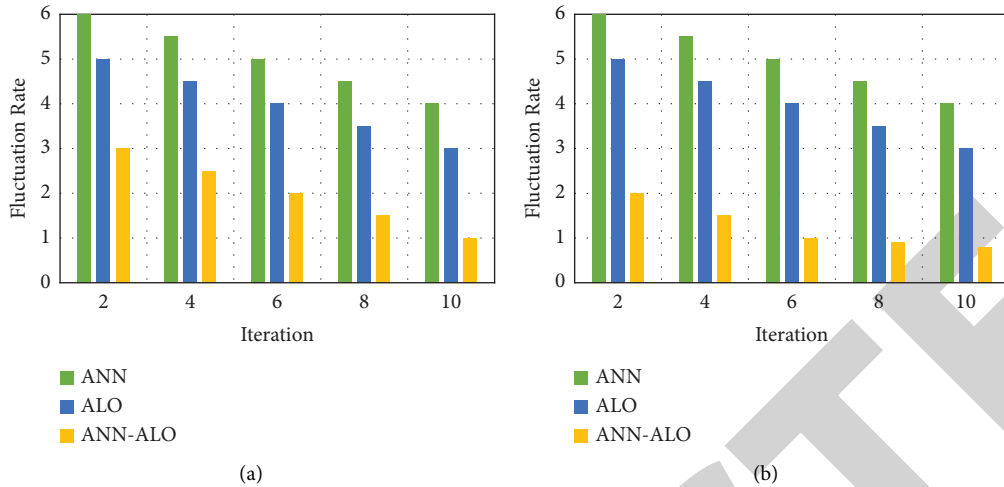


FIGURE 3: Fluctuation rate. (a) RES mode and (b) grid-connected mode.

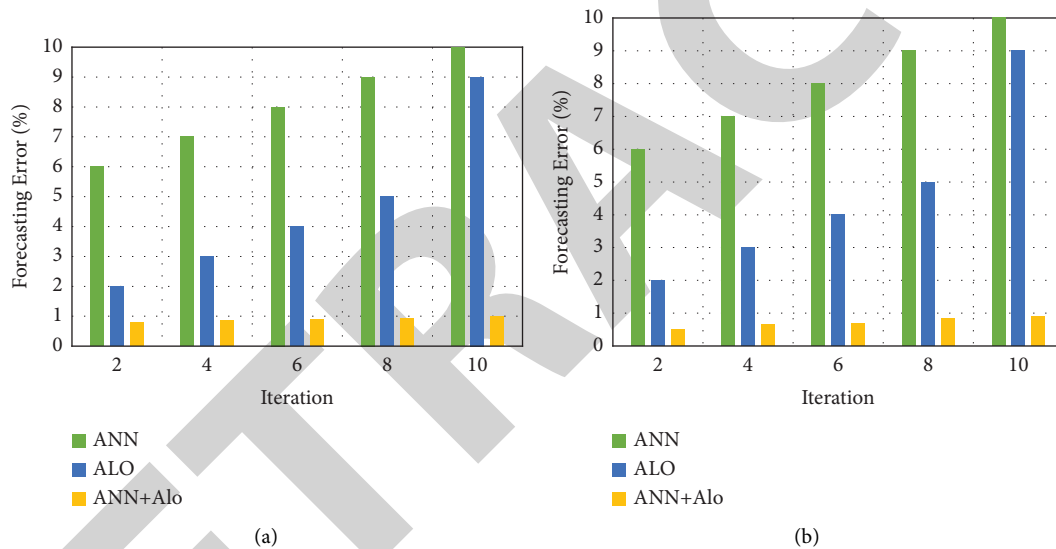


FIGURE 4: Forecasting error (%). (a) RES mode and (b) grid connected mode.

effectiveness of the strategy for managing the MOOD problem of the investigated MG.

The ant lion optimizer (ALO) algorithm, a new optimization technique, is used in this article to address a number of electrical power system issues, such as the reduction of fuel costs, the reduction of active and reactive power losses, the coordination of overcurrent relays, the improvement of the performance of brushless DC wheel motors, and the improvement of the efficiency of isolated protection transformers. The ALO algorithm gives better outcomes and convergence capability for the electrical power system problem when compared to the firefly algorithm and particle swarm optimization. Several optimization techniques were used to address problems with the electrical power supply. The recently published ant lion optimizer (ALO) algorithm is used in these studies to address power system problems. The ALO algorithm was devised in 2015 by Seyedali Mirjalili. The suggested method has a very high rate

of convergence and only needs a few parameter adjustments. As a result, it can be used to solve both restricted and unrestricted optimization techniques. When analyzing weaknesses in power systems, the ALO algorithm performs effectively. Results show how effective the suggested algorithm is by contrasting the competitive advantages of the ALO algorithm to those of other techniques.

5. Conclusion and Future Work

In this study, we introduced a unique energy management system for the day-ahead optimal power management and the control of an MG, comprising of several distributed generator types, including solar arrays, wind turbines, diesel generators, microturbines, fuel cells, and battery storage systems. The suggested EMS is built with a two-layer architecture, using an ant lion optimizer algorithm to handle the multiobjective optimization dispatch problem as well as

fuzzy logic as the primary controller. Operating costs, pollutant emission levels, and the cost of conversion device power loss are three competing objectives functions that are taken into account when attempting to minimize them, considering the ideal scheduling of the battery's cycles of charging and discharging, control of load curtailment, and the technological limitations of the system. Two alternate operating policies, grid connected and standalone mode, are studied to assess the performance of the constructed model, and a comparison with existing heuristic approaches is suggested. A point of the common coupling ensures that investigated MG system is connected to the main grid (PCC). Finally, a centralized EMS designed for coordinated operation and MG system dispatch optimization is connected to each of those units. While conventional energy sources consist of a diesel generator (DG), a fuel cell (FC), and a microturbine, renewable energy sources combine photovoltaic arrays (PV) and wind turbines (WT) (MT). A battery system is used as a backup because of the stochastic nature of RESs in order to control power balance and increase the authenticity of the MG. The work that will be done in the future can be done with a variety of novel controlling techniques that can be used by creating hybrid algorithms, whose performance characteristics can be improved in terms of effectiveness, speed of response, and so on.

Data Availability

The datasets used and/or analyzed during the current study are available from the corresponding author on reasonable request.

Conflicts of Interest

The authors declare that there are no conflicts of interest.

References

- [1] K. R. Suja, "Mitigation of power quality issues in smart grid using levy flight based moth flame optimization algorithm," *Journal of Ambient Intelligence and Humanized Computing*, vol. 12, no. 10, pp. 9209–9228, 2021.
- [2] G. Lei, H. Song, and D. Rodriguez, "Power generation cost minimization of the grid-connected hybrid renewable energy system through optimal sizing using the modified seagull optimization technique," *Energy Reports*, vol. 6, pp. 3365–3376, 2020.
- [3] K. K. Kaduguru, "Power quality improvements in grid connected PV system using novel optimization technique," *International Journal of Recent Technology and Engineering*, vol. 8, 2019.
- [4] B. S. Goud and B. L. Rao, "Power quality enhancement in grid-connected PV/Wind/Battery using UPQC: Atom search optimization," *Journal of Electrical Engineering and Technology*, vol. 16, no. 2, pp. 821–835, 2021.
- [5] G. Arunsankar and S. Srinath, "Harmonics mitigation in hybrid shunt active power filter connected renewable energy source using an intelligent controller," *Transactions of the Institute of Measurement and Control*, vol. 43, no. 1, pp. 102–121, 2021.
- [6] B. S. Goud, B. L. Rao, and C. R. Reddy, "An intelligent technique for optimal power quality reinforcement in a grid-connected HRES system: EVORFA technique," *International Journal of Numerical Modelling: Electronic Networks, Devices and Fields*, vol. 34, no. 2, 2020.
- [7] M. Selvaraj and E. C. Kannan, "Enhancing power in a grid-connected system using unified power quality conditioner with black widow optimization-based floating photovoltaic system," *International Journal of Energy Research*, vol. 46, no. 3, pp. 3095–3114, 2021.
- [8] P. S. Gangadhar, "Performance of IUPQC for multi-feeder systems using particle swarm optimization (PSO) and multilevel-inverter with grid integration of hybrid renewable energy system," *International Journal for Research in Applied Science and Engineering Technology*, vol. 9, no. 11, pp. 941–952, 2021.
- [9] M. A. Basit, S. Dilshad, R. Badar, and S. M. Sami ur Rehman, "Limitations, challenges, and solution approaches in grid-connected renewable energy systems," *International Journal of Energy Research*, vol. 44, no. 6, pp. 4132–4162, 2020.
- [10] A. Riyaz, P. K. Sadhu, A. Iqbal, and M. Tariq, "Power quality enhancement of a hybrid energy source powered packed e-cell inverter using an intelligent optimization technique," *Journal of Intelligent and Fuzzy Systems*, vol. 42, no. 2, pp. 817–825, 2022.
- [11] G. S. Rao, B. S. Goud, and C. R. Reddy, "Power quality improvement using ASO technique," in *Proceedings of the 2021 9th International Conference on Smart Grid (icSmart-Grid)*, pp. 238–242, Setubal, Portugal, June 2021.
- [12] C. R. Reddy, B. S. Goud, F. Aymen, G. S. Rao, and E. C. Bortoni, "Power quality improvement in HRES grid connected system with FOPID based Atom search optimization technique," *Energies*, vol. 14, no. 18, p. 5812, 2021.
- [13] D. A. Konneh, H. O. Howlader, R. Shigenobu, T. Senjyu, S. Chakraborty, and N. Krishna, "A multi-criteria decision maker for grid-connected hybrid renewable energy systems selection using multi-objective particle swarm optimization," *Sustainability*, vol. 11, no. 4, p. 1188, 2019.
- [14] S. G. B, "BWO strategy for power quality improvement in HRES grid-connected DPFC system," *Smart Science*, vol. 9, no. 3, pp. 226–243, 2021.
- [15] K. Sureshkumar and V. Ponnusamy, "Hybrid renewable energy systems for power flow management in smart grid using an efficient hybrid technique," *Transactions of the Institute of Measurement and Control*, vol. 42, no. 11, pp. 2068–2087, 2020.
- [16] S. Choudhury, S. K. Acharya, R. K. Khadanga et al., "Harmonic profile enhancement of grid connected fuel cell through cascaded H-bridge multi-level inverter and improved Squirrel search optimization technique," *Energies*, vol. 14, no. 23, p. 7947, 2021.
- [17] R. Thumu, K. Harinadha Reddy, and C. Rami Reddy, "Unified power flow controller in grid-connected hybrid renewable energy system for power flow control using an elitist control strategy," *Transactions of the Institute of Measurement and Control*, vol. 43, no. 1, pp. 228–247, 2021.